


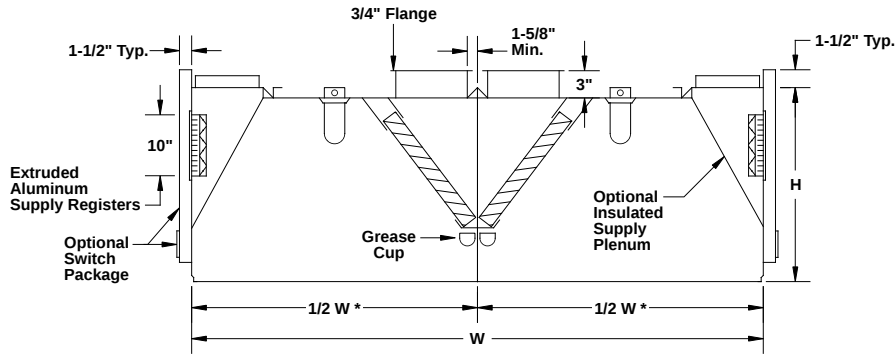


KSI-300T ISLAND HOOD

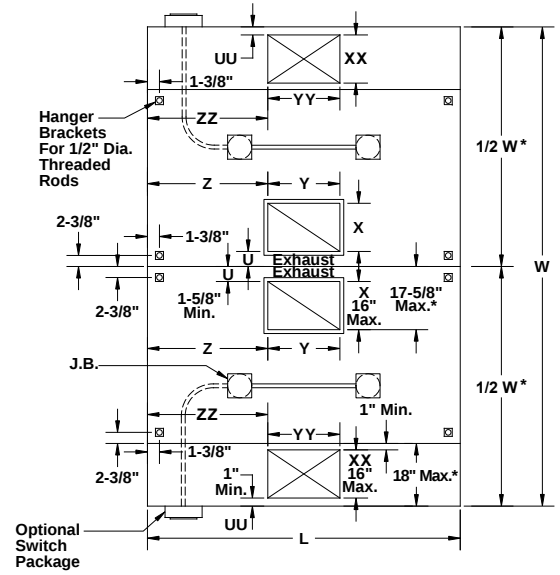

**BRACKET
DETAIL**

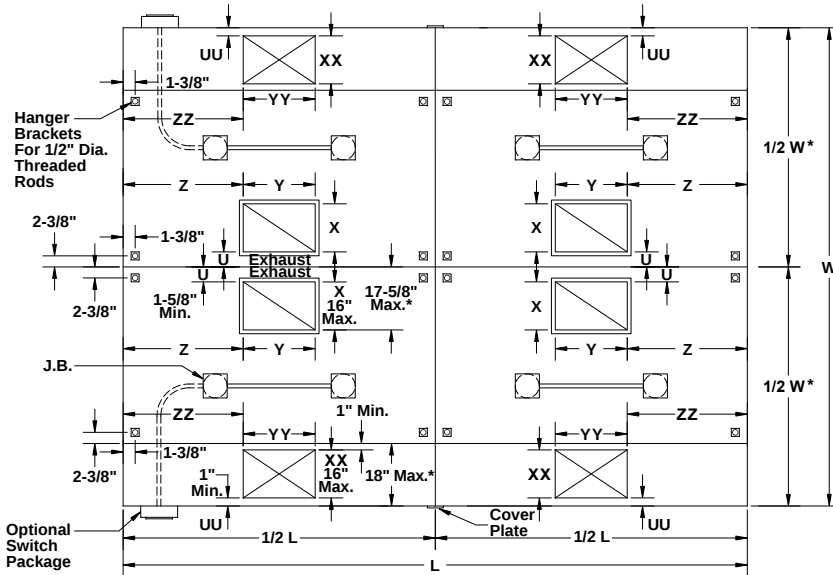

* IF HOOD WIDTH (1/2 W) LESS THAN 48" IS REQUIRED, CONTACT FACTORY FOR COLLAR DIMENSIONAL LIMITATIONS.

Quantity	① Material	② Gauge	Hood Dimensions			③ Number of Lights	④ Factory Cut Exhaust Opening *			
			L	W	H		U	X	Y	Z
④ Factory Cut Supply Opening *				⑤ Filters				⑥ Finish	Other Options	Tag
UU	XX	YY	ZZ	Type	Material	Quantity	Size			

- ① Type 304 or 430 stainless steel.
- ② 18 ga. is standard: other gauges available.
- ③ Standard is 100 watt vapor proof incandescent U.L. Listed for use on grease exhaust hood.
- ④ 2 sets of collars required on hood sections over 12' long.
- ⑤ Aluminum baffle type U.L. Classified filters standard.



Intertek

- ☐ Without Exhaust Fire Damper
- ☐ With Exhaust Fire Damper

- ⑥ #3 polish standard.
- ⑦ Optional exhaust air fire damper.
- ⑧ Optional supply air fire damper (not required by U.L.).
- ⑨ Optional supply air collar balancing damper.
- ⑩ Optional switch package with surface mounted stainless steel cover and junction box on top of hood. (Fan switch with illuminated toggle).
 - ☐ Hood mounted ☐ Loose for wall mounting
- Number of light switches _____
- Number of fan switches _____ Voltage _____ 115V _____ 24V
- ⑪ Optional insulated plenum.



To maintain our policy of continuous product development, we reserve the right to change prices, specifications, ratings and dimensions without notice or obligation.

Project				Location	
Engineer				 KEES INCORPORATED 400 S. Industrial Dr. Elkhart Lake, WI 53020 Phone: (920) 876-3391 Fax: (920) 876-3065 Website: www.kees.com	
Architect				Dwg. No.	SD-KSI-300T
Contractor				Date	12/17